



REVISIONS				APPROVALS	
DESCRIPTIONS	BY	DATE	APPROVED		

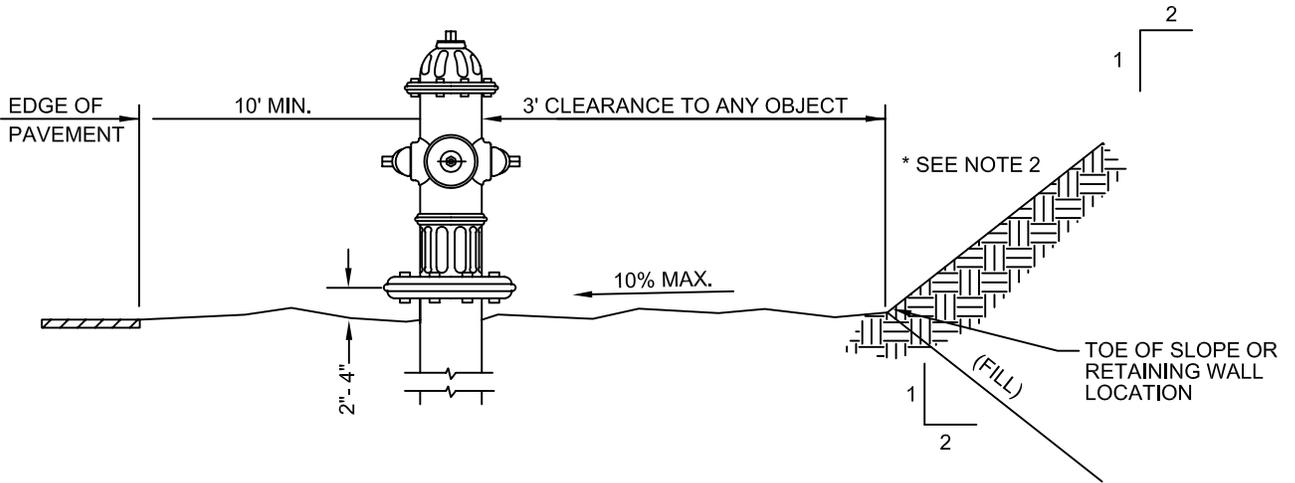

FIRE HYDRANT LOCATION WITHOUT SIDEWALK

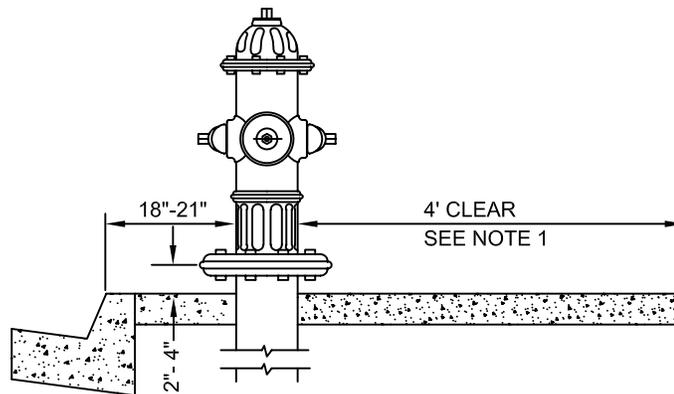

FIRE HYDRANT LOCATION WITH SIDEWALK

NOTES:

1. FOR INTEGRAL SIDEWALKS OF LESS THAN 6' WIDTH, HYDRANT SHALL BE PLACED BEHIND SIDEWALK AND BE 12" CLEAR OF SIDEWALK.
2. RETAINING WALL MAY BE REQUIRED FOR CLEARANCE.
3. FIRE HYDRANTS SHALL BE A MINIMUM OF 5 FEET FROM DRIVEWAY APPROACHES OR OTHER TRAFFIC HAZARDS.
4. HYDRANT LOCATION TO BE APPROVED BY AMWC ON PLANS AND IN FIELD.
5. FIRE HYDRANTS SHALL BE IN THE RIGHT-OF-WAY UNLESS OTHERWISE APPROVED BY AMWC.
6. HYDRANT TYPE AND LOCATION ARE TO BE APPROVED BY AMWC.

DRAWN BY: MRW DESIGNED BY: AMWC DATE: 9/6/06 FILE NAME: F-6.DWG	CITY OF ATASCADERO ENGINEERING DEPARTMENT FIRE HYDRANT LOCATION	DRAWING NO. F-6
--------------------------------------------------------------------------------------	----------------------------------------------------------------------------------	-------------------------------